Job Name/Location: Tag No:

For: File Resubmit Date: Approval Other PO No.:

Architect: GC: Mech: Engr:

Rep:

(Project Manager)

LMU363HV

Multi F Inverter Heat Pump Outdoor Unit

Performance:

| Cooling Capacity (MinRated-Max., Btu/h) | 8,400~32,800~38,400 |
|---|----------------------|
| Heating Capacity (MinRated-Max., Btu/h) | 10,080~36,000~41,600 |
| Max. Heating Capacity at 5°F (Btu/h) | 25,200 |
| Max. Heating Capacity at 0°F (Btu/h) | 22,750 |
| Max. Heating Capacity at -4°F (Btu/h) | 20,800 |
| EER2 | 12.5 |
| SEER2 | 21.5 |
| COP | 3.9 |
| HSPF2 | 9.0 |

Cooling Nominal Test Conditions: Heating Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Indoor: 70°F DB / 60°F WB Outdoor: 95°F DB / 75°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

| Power Supply (V/Hz/Ø) ¹ | 208-230V, 60, 1 |
|------------------------------------|-----------------|
| MOP (A) | 25 |
| MCA (A) | 18.4 |
| Recommended Fuse Size (A) | 25 |
| Cooling Rated Amps (A) | 15.03 |
| Heating Rated Amps (A) | 15.03 |
| Compressor (A) | 13.5 |
| Fan Motor (A) | 0.73 |
| Locked Rotor Amps (A) | 19.0 |

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

Piping:

| Refrigerant Charge (lbs.) | 6.17 |
|---|------------|
| Liquid Line Connection (in., O.D.) | 1/4 x 4 |
| Vapor Line Connection (in., O.D.) | 3/8 x 4 |
| Maximum Total Piping ² (ft.) | 246.1 |
| Min. / Max. ODU to IDU Piping (ft.) | 9.8 / 82.0 |
| Piping Length (no add'l refrigerant, ft.) | 98.4 |
| Maximum Elevation between ODU and IDU (ft.) | 49.2 |
| Maximum Elevation between IDU and IDU (ft.) | 24.6 |

ODU = Outdoor Unit IDU = Indoor Unit

Features:

- Auto operation
- Auto restart
- Inverter (variable speed compressor)
- Defrost / Deicing
- Restart delay (three [3] minutes)
- Self diagnosis
- Soft start
- Low ambient cooling down to 14°F



Operating Range:

| Cooling (°F DB) | 14 to 118 |
|-----------------|-----------|
| Heating (°F WB) | -4 to +64 |

Unit Data:

| Refrigerant Type | R410A |
|--|---------------|
| Refrigerant Control | EEV |
| Sound Pressure (Cool / Heat) ±1 dB(A) ³ | 51 / 54 |
| Net / Shipping Weight (lbs.) | 138.9 / 154.3 |
| Heat Exchanger Coating | Gold Fin™ |
| Minimum No. of Indoor Units | 2 |
| Maximum No. of Indoor Units | 4 |

Compressor:

| Туре | | Twin Rotary |
|-------|-------|-------------|
| Quar | ntity | 1 |
| Oil / | Туре | FVC68D |

Fan:

| Туре | Propeller |
|-------------------------|---------------------------------------|
| Quantity | 1 |
| Motor / Drive | Brushless Digitally Controlled/Direct |
| Max. Airflow Rate (CFM) | 2.119 |

Notes:

- 1. Acceptable operating voltage: 187V 253V.
- 2. Piping lengths are equivalent.
- 3. Sound pressure levels are tested in an anechoic chamber under ISO Standard
- 4. All power / communication cable to be minimum 14 AWG, 4-conductor, stranded, shielded or unshielded wire, and must comply with applicable local and national codes. If shielded, the wire must be grounded to the chassis at the outdoor unit only.
- 5. Power wiring size must comply with the applicable local and national codes.
- 6. This data is rated 0 ft. above sea level, with 0 ft. level difference between outdoor and indoor units, and the following refrigerant pipe lengths:

LMU183HV: 16.4 ft. x 2 = 32.8 ft. LMU243HV: 16.4 ft. x 3 = 49.2 ft.

LMU303HV: 16.4 ft. x 4 = 65.6 ft.

LMU363HV: 16.4 ft. x 4 = 65.6 ft.

All capacities are net with a combination ratio between 95 - 105%.

- 7. Must follow installation instructions in the applicable LG installation manual.
- 8. Refer to the Combintion Data Manual for combination capacity tables.
- 9. See the Performance Data Manual for sensible and latent capacities.



☐ PI-485 - PMNFP14A1 ☐ MultiSITE Comm. Mgr. -PBACNBTR0A

☐ AC Smart 5 - PACS5A000 ☐ ACP 5 - PACP5A000

☐ Power Distribution Indicator (PDI)

Premium - PQNUD1S41

☐ Mobile LGMV - PLGMVW100 ☐ Drain Pan Heater - PQSH1200 □Low Ambient Baffle Kit (Cooling operation to -4°F) - ZLABGP04A










SB_MultiF_LMU363HV_2022_07_18_084716


LMU363HV Multi F Inverter Heat Pump Outdoor Unit




| f | 26 | (1-1/32) | | . г∨т | 28(1–1/8) |
|---------------|---------|----------|---|-------|-----------|
| 397(16–21/32) | 330(13) | | • | | |
| 38 | | | ♦ | | |
| ŧ | | | | LvJ | 35(6-1/2) |

[Unit : mm(inch)]

Gravity point

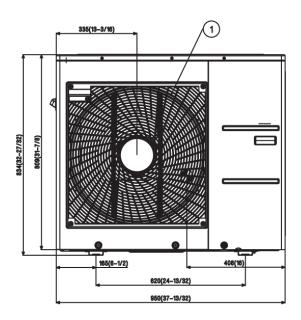

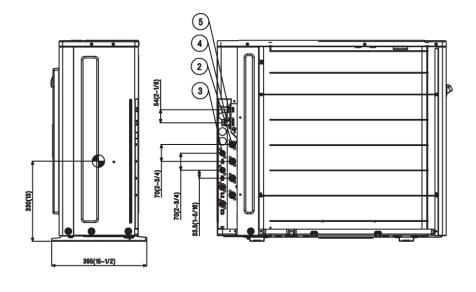

| Nia | Dort Name |
|-----|-----------------------------|
| No. | Part Name |
| 1 | Air discharge grille |
| 2 | Vapor pipe connection |
| 3 | Liquid pipe connection |
| 4 | Main service valve (Liquid) |
| 5 | Main service valve (Vapor) |

Notes:

- 1. Unit must be installed in compliance with the installation manual.
- 2. Unit must be grounded in accordance with the local or state regulations and applicable national codes.
- 3. All field-supplied electrical components and materials must comply with local, state, and national codes.
- 4. Electrical characteristics must be considered for electrical work and design. The capacity of power cable and circuit breaker for the outdoor unit must follow local, state, national, and manufacturer requirements.

Job Name/Location: Tag #: For: File Resubmit Date: Approval Other_ PO No .: GC: Architect: Mech: Engr: Rep: (Project Manager) (Company)





LAN090HSV5

Multi F Wall Mounted Art Cool™ Mirror Indoor Unit 9,000 Btu/h



Performance:

| Nominal Cooling Capacity (Btu/h) | 9,000 |
|----------------------------------|--------|
| Nominal Heating Capacity (Btu/h) | 10,900 |

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

| Powe | er Supply (V'/Hz/Ø) | 208-230/60/1 |
|------|---------------------|--------------|
| Rate | d Amps (A) | 0.4 |

Piping:

| Installed Liquid Pipe (in., O.D.) | ø1/4 |
|-----------------------------------|------------|
| Installed Vapor Pipe (in., O.D.) | ø3/8 |
| Liquid Connection (in., O.D.) | ø1/4 |
| Vapor Connection (in., O.D.) | ø3/8 |
| Drain (in., O.D. / I.D.) | 27/32,5/8 |
| Temperature Sensor | Thermistor |

Controls Features:

- 4-Way auto swing
- 24-Hour on/off timer
- Auto operation
- Auto restart Chaos wind
- Inverter (variable speed fan)
- Jet cool/Jet heat
- 3M Micro Filter
- · Self-cleaning indoor coil
- Sleep mode
- Condensate sensor connection
- Built-in Wi-Fi via Smart ThinQ app
- Compatible with Single Zone
- **HSV5 Outdoor Units**

Included Accessories:

• Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

| Cooling (°F DB) | 57 ~ 77 |
|-----------------|---------|
| Heating (°F WB) | 59 ~ 81 |

Unit Data:

| Refrigerant Type | R410A |
|--|---------------------|
| Refrigerant Control | EEV |
| Sound Pressure (H/M/L) (±3 dB[A]) ² | 36 / 32 / 27 |
| Primary Filter | Washable Pre-filter |
| Secondard Filter | 3M Micro Dust |
| Net Weight (lbs.) | 20.5 |
| Shipping Weight (lbs.) | 25.6 |
| 1 | |

Fan:

| Туре | Cross Flow |
|----------------------|---------------------------------------|
| Quantity | 1 |
| Motor/Drive | Brushless Digitally Controlled/Direct |
| Air Flow H/M/L (CFM) | 268 / 218 / 169 |
| | |

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with the applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation instructions in the applicable LG installation manual.







| Inh | Mama | /Location: |
|-----|----------|-------------|
| JUU | I Vallic | , Lucation. |

LAN090HSV5


Multi F Wall Mounted Art Cool™ Mirror Indoor Unit 9,000 Btu/h



Tag No.: _______

Date: ______

PO No.: ______

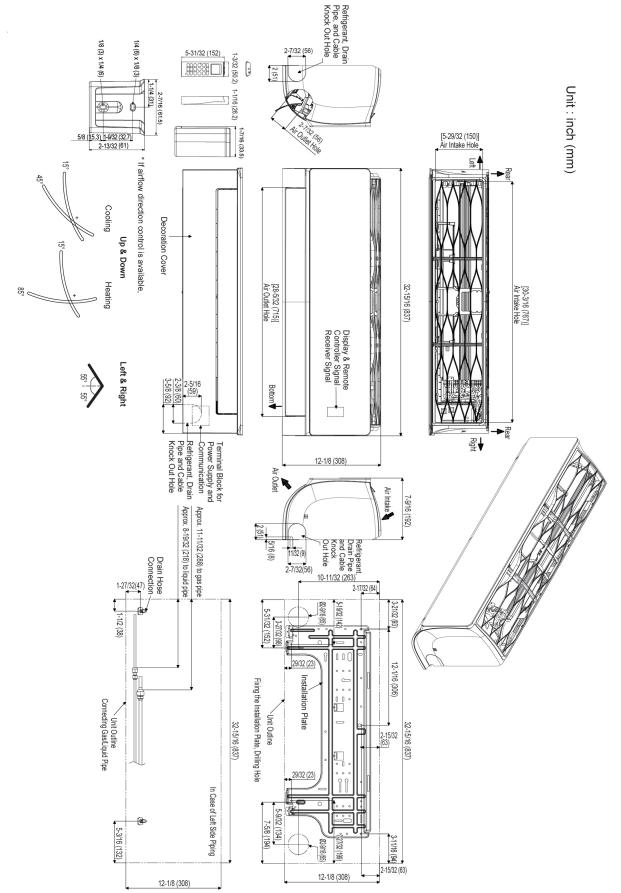

Job Name/Location: Tag #: For: File Resubmit Date: Approval Other_ PO No .: GC: Architect: Mech: Engr: Rep: (Project Manager) (Company)



LAN120HSV5

Multi F Wall Mounted Art Cool™ Mirror Indoor Unit 12,000 Btu/h



Performance:

| Nominal Cooling Capacity (Btu/h) | 12,000 |
|----------------------------------|--------|
| Nominal Heating Capacity (Btu/h) | 13,600 |

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

| Powe | er Supply (V'/Hz/Ø) | 208-230/60/1 |
|------|---------------------|--------------|
| Rate | d Amps (A) | 0.4 |

Piping:

| Installed Liquid Pipe (in., O.D.) | ø1/4 |
|-----------------------------------|-------------|
| Installed Vapor Pipe (in., O.D.) | ø3/8 |
| Liquid Connection (in., O.D.) | ø1/4 |
| Vapor Connection (in., O.D.) | ø3/8 |
| Drain (in., O.D. / I.D.) | 27/32 , 5/8 |
| Temperature Sensor | Thermistor |

Controls Features:

- 4-Way auto swing
- 24-Hour on/off timer
- Auto operation
- Auto restart
- Chaos wind • Inverter (variable speed fan)
- Jet cool/Jet heat
- 3M Micro Filter
- · Self-cleaning indoor coil
- Sleep mode
- Condensate sensor connection
- Built-in Wi-Fi via Smart ThinQ app
- Compatible with Single Zone
- **HSV5 Outdoor Units**

Included Accessories:

• Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

| Cooling (°F DB) | 57 ~ 77 |
|-----------------|---------|
| Heating (°F WB) | 59 ~ 81 |

Unit Data:

| Refrigerant Type | R410A |
|--|---------------------|
| Refrigerant Control | EEV |
| Sound Pressure (H/M/L) (±3 dB[A]) ² | 38 / 34 / 29 |
| Primary Filter | Washable Pre-filter |
| Secondard Filter | 3M Micro Dust |
| Net Weight (lbs.) | 20.5 |
| Shipping Weight (lbs.) | 25.6 |
| | |

Fan:

| Туре | Cross Flow |
|----------------------|---------------------------------------|
| Quantity | 1 |
| Motor/Drive | Brushless Digitally Controlled/Direct |
| Air Flow H/M/L (CFM) | 282 / 233 / 177 |
| | |

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with the applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation instructions in the applicable LG installation manual.








LAN120HSV5

Multi F Wall Mounted Art Cool™ Mirror Indoor Unit 12,000 Btu/h



Tag No.: ______

Date: _____

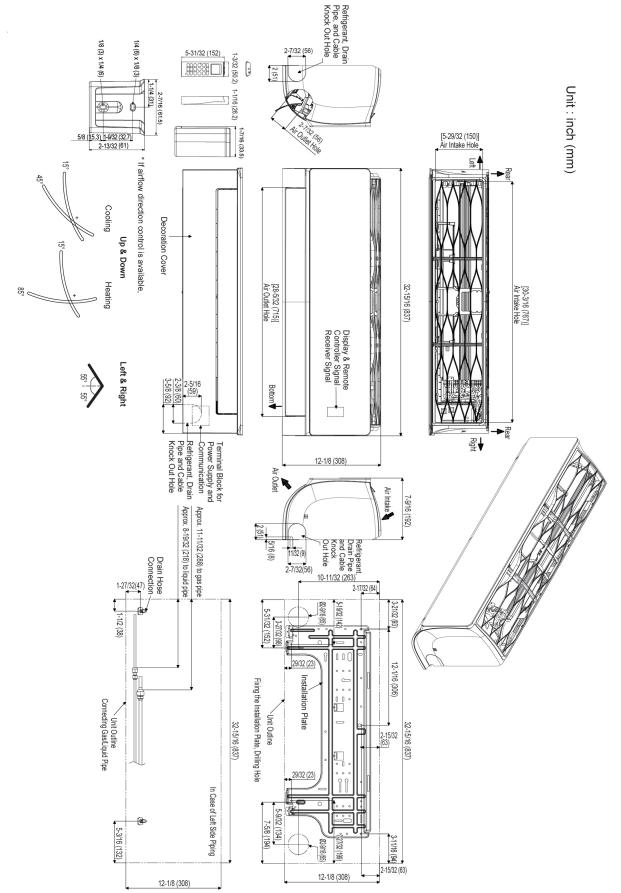

Job Name/Location: Tag #: For: File Resubmit Date: Approval Other_ PO No .: GC: Architect: Mech: Engr: Rep: (Project Manager) (Company)



LAN120HSV5

Multi F Wall Mounted Art Cool™ Mirror Indoor Unit 12,000 Btu/h



Performance:

| Nominal Cooling Capacity (Btu/h) | 12,000 |
|----------------------------------|--------|
| Nominal Heating Capacity (Btu/h) | 13,600 |

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

| Powe | er Supply (V'/Hz/Ø) | 208-230/60/1 |
|------|---------------------|--------------|
| Rate | d Amps (A) | 0.4 |

Piping:

| Installed Liquid Pipe (in., O.D.) | ø1/4 |
|-----------------------------------|-------------|
| Installed Vapor Pipe (in., O.D.) | ø3/8 |
| Liquid Connection (in., O.D.) | ø1/4 |
| Vapor Connection (in., O.D.) | ø3/8 |
| Drain (in., O.D. / I.D.) | 27/32 , 5/8 |
| Temperature Sensor | Thermistor |

Controls Features:

- 4-Way auto swing
- 24-Hour on/off timer
- Auto operation
- Auto restart
- Chaos wind • Inverter (variable speed fan)
- Jet cool/Jet heat
- 3M Micro Filter
- · Self-cleaning indoor coil
- Sleep mode
- Condensate sensor connection
- Built-in Wi-Fi via Smart ThinQ app
- Compatible with Single Zone
- **HSV5 Outdoor Units**

Included Accessories:

• Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

| Cooling (°F DB) | 57 ~ 77 |
|-----------------|---------|
| Heating (°F WB) | 59 ~ 81 |

Unit Data:

| Refrigerant Type | R410A |
|--|---------------------|
| Refrigerant Control | EEV |
| Sound Pressure (H/M/L) (±3 dB[A]) ² | 38 / 34 / 29 |
| Primary Filter | Washable Pre-filter |
| Secondard Filter | 3M Micro Dust |
| Net Weight (lbs.) | 20.5 |
| Shipping Weight (lbs.) | 25.6 |
| 1 | |

Fan:

| Туре | Cross Flow |
|----------------------|---------------------------------------|
| Quantity | 1 |
| Motor/Drive | Brushless Digitally Controlled/Direct |
| Air Flow H/M/L (CFM) | 282 / 233 / 177 |
| | |

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with the applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation instructions in the applicable LG installation manual.







LAN120HSV5

Multi F Wall Mounted Art Cool™ Mirror Indoor Unit 12,000 Btu/h



Tag No.: ______

Date: _____

